



Smart choice for power™

Owner's Guide

Thank you for purchasing the LinkLITE high precision battery monitor.

Important

Misusing or incorrectly connecting the LinkLITE may damage the equipment. Read and keep this Owner's Guide and the enclosed Installation Guide.

WARNING: Fire hazard

Do not operate this product unless it has been installed by a qualified installer, in accordance with applicable codes and the Installation Guide.

WARNING


Do not use LinkLITE in connection with life support systems, medical equipment, or where human life or medical property may be at stake.

FCC Information

This Class B digital apparatus complies with Canadian ICES-003 and Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation. NOTE: The Class B limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

LinkLITE Display and Control Overview

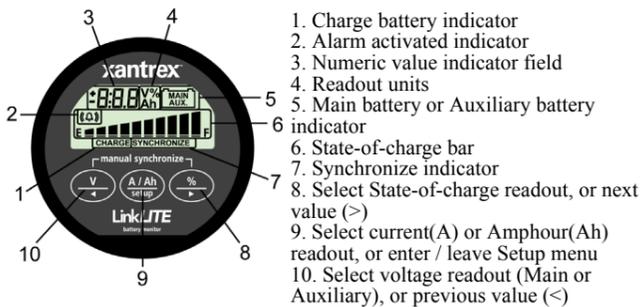

1. Charge battery indicator
2. Alarm activated indicator
3. Numeric value indicator field
4. Readout units
5. Main battery or Auxiliary battery indicator
6. State-of-charge bar
7. Synchronize indicator
8. Select State-of-charge readout, or next value (>)
9. Select current(A) or Amphour(Ah) readout, or enter / leave Setup menu
10. Select voltage readout (Main or Auxiliary), or previous value (<)


Synchronization

In order to keep your LinkLITE battery monitor delivering accurate status information about your battery, it is important to regularly synchronize your battery monitor with your battery. As explained in the quick start guide, a synchronization step is also needed before you can actually use your battery monitor. During operation, the battery monitor automatically indicates when a synchronization is required, by displaying the message SYNCHRONIZE. A synchronization step means nothing more than performing a complete charge cycle on your battery. A charge cycle will be considered complete when both Auto-sync parameters F02 and F03 are met during at least 4 minutes. This typically means : when the battery charger switches to float mode. By meeting these conditions, the battery is considered full, which will be indicated by a flashing FULL message on the display. Besides this, the State-of-charge readout will be set to 100% and the Amphour readout reset to 0Ah. The FULL message will disappear when a key is pressed, or automatically, when the battery starts discharging again.

Performing synchronizations regularly is also important to keep your battery healthy and to increase it's lifetime. You will notice that if you are often performing full charge cycles yourselves, the battery monitor will most likely not display the SYNCHRONIZE message, since the battery is already kept in good sync with the battery monitor. Besides automatic synchronizations based on meeting the Auto-Sync Functions, you can also manually synchronize the battery monitor with your battery when you are sure your battery is fully charged. This can be accomplished by pressing both < and > keys simultaneously for three seconds. After these three seconds, the flashing FULL message appears on the the display just like when it is automatically synchronized.

Setup menu

Using the Setup menu, your battery monitor can be adjusted to fit into your system. A number of parameters, called Functions, can be set according to your needs. This menu can be accessed by the following sequence :



When the Setup menu is entered, you can use the < and > keys to browse through the different Functions. By pressing the SETUP key, the selected Function value can be viewed. The < and > keys can now be used to change this value. Pressing the SETUP key again, will then step back to the Setup menu. From any menu position, the Normal Operating Mode can be accessed again by pressing the SETUP key for 3 seconds. This will also save any Function value changes to internal memory. When no keys are pressed for 90 seconds while operating in the Setup menu, the battery monitor will automatically return to the Normal Operating Mode again without saving any Function value changes. The factory settings are based on a 12V battery system with a capacity of 200Ah. For 12V systems, generally only Function F01 has to be checked for correct operation of your battery monitor. When your battery capacity is other than 200Ah, Function F01 has to be changed to a value that is equal to your battery capacity. All other Functions can be left unchanged if you are uncertain about adjusting these values yourselves.

When your battery system is 24V, besides checking battery capacity Function F01 for the correct value, you should also change the values of F02 and F05. Default 24V system values for F02 and F05 are respectively 26.4V and 21.0V. The following Functions are available :

F01	Battery capacity. Your Main battery's capacity in Amphours (Ah). Default: 200Ah Range: 20 – 999Ah Step size: 1Ah
F02	Charger's float voltage (Auto-sync parameter). This value must be equal to your battery charger's float voltage, which is the last stage of the charging process. In this stage the battery is considered full. Default: 13.2V Range: 8.0V – 33.0V Step size: 0.1V
F03	Charger's float current (Auto-sync parameter). When the charge current is below this percentage of the battery capacity (see Function F01), the battery will be considered as fully charged. Make sure this Function value is always greater than the minimum current at which the charger maintains the battery or stops charging. Default: 2.0% Range: 0.5 – 10.0% Step size: 0.1%
F04	Low battery alarm On (% SOC). When the State-of-charge percentage has fallen below this value, the alarm relay will be activated, the Charge battery indicator starts flashing and the State-of-charge bar is empty. Default: 50% Range: 0 – 99% Step size: 1%
F05	Low battery alarm On (Volts). When the battery voltage has fallen below this value, the alarm relay will be activated. Default: 10.5V Range: 8.0 – 33.0V Step size: 0.1V
F06	Low battery alarm Off (% SOC). When the State-of-charge percentage has risen above this value and the alarm relay was activated, the alarm relay will deactivate again. When "FULL" is selected, the alarm relay is deactivated when the Auto-sync parameters are met. Default: 80% Range: 1 – 100% /FULL Step size: 1%
F07	Peukert's exponent. The Peukert's exponent represents the effect of reducing battery capacity at higher discharge rates. When the Peukert value of your battery is unknown, it is recommended to keep this value at 1.25. A value of 1.00 disables the Peukert compensation and could be used for Lithium based batteries. Default: 1.25 Range: 1.00 – 1.50 Step size: 0.01
F08	Shunt Amp Rating. This Function represents the Amp rating of your shunt at 50mV. Included with your battery monitor is a 500Amp/50mV shunt, meaning that at 500A flowing through the shunt, a voltage of 50mV is generated across the small 'Kelvin' screw terminals of the shunt. This voltage will be used by the battery monitor to measure the amount of current. Default: 500A Range: 10 – 900A Step size: variable
F09	Backlight mode. Represents the duration of backlight activation in seconds after key-press. The backlight can also be set to be always "ON" or always "OFF". Function setting "AU", activates the backlight automatically when charge / discharge current exceeds 1Amp or when a key is pressed. Default: 30sec Range: OFF / 5 – 300sec Step size: variable / ON / AU
F10	Alarm contact polarity. Enables selection between a normally open (NO) or normally closed (NC) contact. Default: NO Range: NO / NC
F11	Auto-sync sensitivity. Only change this setting when F02 and F03 are set correctly and automatic synchronization still fails. If automatic synchronization takes too long or does not occur, lower this value. When the battery monitor synchronizes too early, increase this value. Default: 5 Range: 0 – 10 Step size: 1
F12	Firmware version. Displays the firmware version of the battery monitor (read only). Default: x.xx

The last three Functions are called Reset Functions. By pressing the SETUP key

the selected Reset Function can be viewed. The default value for all Reset Functions is "OFF". To actually reset the selected Function, use the < and > keys to change the value from "OFF" to "ON". Pressing the SETUP key again, will step back to the Setup menu. All reset items set to "ON" will only be reset once the Normal Operating Mode is accessed again by pressing the SETUP key for 3 seconds. The following Reset Functions are available :

r.b	Reset Battery status. Use this reset item to reset your current battery status, for example after you have installed a fresh battery of the same specifications as the previous one.
r.F	Reset Functions. This reset item can be used to reset all Function values to factory default values.
r.c	Reset zero-offset current. Use this reset item to remove small current readings on the display when no current is flowing in- or out of the battery. When performing this reset action, please be 100% sure that all DC consumers/chargers are disconnected or turned off.

Specifications

Parameter	LinkLITE
Supply voltage range	9 – 35VDC
Supply current ^a @Vin=24VDC	7mA
@Vin=12VDC	9mA
Input voltage range (auxiliary battery)	2 – 35VDC
Input voltage range (main battery)	0 – 35VDC
Input current range ^b	-999 – +999A
Battery capacity range	20 – 999Ah
Operating temperature range	-20 – +50°C
Readout resolution:	voltage (0 – 35V) ±0.1V
	current (0 – 99A) ±0.1A
	current (100 – 999A) ±1A
	amphours (0 – 99Ah) ±0.1Ah
	amphours (100 – 999Ah) ±1Ah
	state-of-charge (0 – 100%) ±1%
Voltage measurement accuracy	±0.3%
Current measurement accuracy	±0.4%
Dimensions:	frontpanel ø 64mm (2.54")
	body diameter ø 52mm (2.05")
	total depth ø 79mm (3.11")
	weight 95grams (0.21 lbs")
Shunt dimensions:	footprint 45 x 87mm (1.77"x3.43")
	(M8 screws) height 17mm (0.67") (base) / 35mm (1.38")
	weight 145grams (0.32lbs)
Protection class	IP20 (frontpanel only IP 65)
Connection Kit	# 854-2021-01 (15m, 50 ft)

a. Measured with backlight and alarm relay turned off

b. Depends on selected shunt. With standard delivered 500A/50mV shunt (350A continuous), the range is limited to -600 – +600A.

Mode d'emploi

Merci d'avoir acheté ce Contrôleur de Batterie LinkLITE.

Informations importantes

Veillez lire le manuel de l'utilisateur pour obtenir des informations concernant la bonne utilisation du produit et ce de manière sécurisée. Veillez conserver ce manuel de l'utilisateur proche du contrôleur de batterie pour référence ultérieure.

AVERTISSEMENT : risque d'incendie


N'utiliser cet appareil que s'il a été installé par un installateur qualifié, et conformément au manuel d'installation.

AVERTISSEMENT :

Les modèles LinkLITE ne sont pas étudiés pour être branchés sur des appareils de maintien des fonctions vitales ou d'autres équipements ou appareils médicaux.

Vue d'ensemble de l'affichage et du contrôle

Voir l'image sur la page suivante.



1. Indicateur 'Charger la batterie'
2. Indicateur 'Alarme activée'
3. Champ indicateur de la valeur numérique
4. Unités relevées
5. Indicateur batterie 'Main' (principale) ou batterie 'Auxiliary' (auxiliaire)
6. Barre d'état de charge
7. Indicateur 'Synchroniser'
8. Sélectionner l'affichage de l'état de charge de l'afficheur, ou la valeur Suivante (>)
9. Sélectionner l'affichage du courant (A) ou des Ampères heures (Ah), ou entrer / quitter
10. Sélectionner l'affichage du voltage ("Main" ou "Auxiliary"), ou la valeur précédente (<)

Synchronisation

Afin de garantir que votre contrôleur de batterie continuera à fournir des informations précises sur l'état de votre batterie, il est important de synchroniser régulièrement le contrôleur de votre batterie avec votre batterie. Comme cela vous est expliqué dans le guide de démarrage rapide, une étape de synchronisation est aussi nécessaire avant que vous puissiez en fait utiliser votre contrôleur de batterie. Pendant l'opération, lorsque la synchronisation est requise, le contrôleur de batterie l'indique automatiquement en affichant le message 'SYNCHRONIZE' (Synchroniser). Une étape de synchronisation ne signifie rien de plus que d'effectuer un cycle de charge complet de votre batterie. Un cycle de charge sera considéré comme complet quand les paramètres Auto-sync F02 et F03 sont rencontrés pendant au moins 4 minutes.


Typiquement, cela signifie lorsque le chargeur de la batterie bascule en mode 'Float' (Entretien). En répondant à ces conditions, la batterie sera considérée comme pleine et cela sera indiqué à l'écran par le message clignotant 'FULL' (pleine). De plus, l'affichage de l'Etat de charge sera réglé à 100% et l'affichage Amphour réinitialisée à 0Ah. Le message 'FULL' disparaîtra lorsque vous appuierez sur une touche ou automatiquement lorsque la batterie commencera à être à nouveau déchargée.

Effectuer des synchronisations régulières est aussi important pour garder votre batterie saine et pour augmenter sa durée de vie. Vous remarquerez que si vous effectuez vous-même des cycles de charge complets , le contrôleur de la batterie n'affichera pratiquement pas le message 'SYNCHRONIZE', puisque la batterie est déjà en bonne synchronisation avec le contrôleur de batterie.

En plus des synchronisations automatiques basées sur la conformité aux Fonctions 'Auto-Sync', vous pouvez aussi synchroniser manuellement le contrôleur de batterie lorsque vous êtes sûr(e) que votre batterie est complètement chargée. Cela peut se faire en appuyant simultanément sur les touches < et > pendant trois secondes. Après ces trois secondes, le message 'FULL' apparaît à l'écran comme lorsque l'appareil est automatiquement synchronisé.

Menu Installation

Dans le menu installation, votre contrôleur de batterie peut être réglé pour correspondre à votre système. Un certain nombre de paramètres, appelés Fonctions, peuvent être réglés selon vos besoins. Il est possible d'accéder à ce menu en suivant la séquence suivante :



Lorsque vous avez accédé au menu installation, vous pouvez utiliser les touches < et > pour parcourir les différentes Fonctions. En appuyant sur la touche Setup, la valeur de Fonction sélectionnée peut être visualisé. Les touches < et > peuvent maintenant être utilisées pour changer cette valeur. En appuyant à nouveau sur la touche Setup, vous retourneriez alors au menu Fonction. Quelque soit votre position dans le menu, vous pouvez à nouveau accéder au Mode Opération Normale en appuyant sur la touche Setup pendant 3 secondes. Cela sauvegardera aussi, dans la mémoire interne, les changements de valeur de la Fonction. Si vous n'appuyez sur aucune touche pendant 90 secondes pendant que vous êtes dans le menu de réglage de Fonction, le contrôleur de la batterie retournera automatiquement en Mode d'Opération Normale sans sauvegarder les changements de valeur de la Fonction.

Les réglages usine sont basés sur une tension batterie 12V ayant une capacité de 200Ah. Pour les installations sous 12V, seule la Fonction F01 a généralement besoin d'être vérifiée pour le bon fonctionnement de votre contrôleur de batterie. Quand votre capacité batterie est autre que 200Ah, la Fonction F01 doit être changée afin d'obtenir une valeur égale à votre capacité batterie. Toutes les autres Fonctions peuvent être laissées inchangées si vous êtes n'êtes pas sur d'ajuster correctement les autres valeurs.

Quand votre installation de batterie est sous 24V, en plus de vérifier la capacité batterie via la Fonction F01, vous devez également changer les valeurs de F02 et de F05. Pour un système en 24V les valeurs par défaut pour F02 et F05 sont respectivement de 26.4V et 21.0V.

Les Fonctions suivantes sont disponibles :

F01	Capacité de la batterie. La capacité de votre Batterie est en Ampères heure (Ah).	Par Défaut : 200Ah	Plage : 20 – 999Ah	Taille d'étape : 1Ah
------------	---	--------------------	--------------------	----------------------

